


# Accessing the Tunnel

- Personnel

- Sign *General Access RWP*
- Have Personal Dosimeter, or Supplemental Reading Pocket Dosimeter (SRPD\*), or escort with SRPD\*
- Wear suitable shoes and clothing

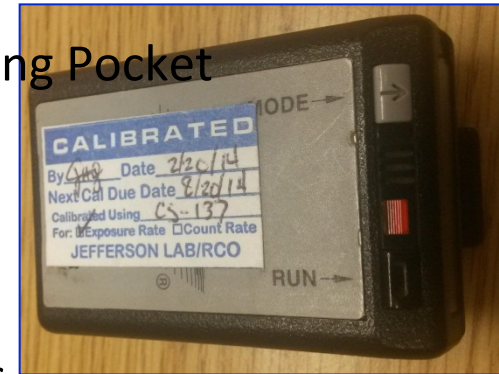

- Machine

- State needs to be *Restricted* or *Controlled Access*
  - *Restricted Access*: Use Controlled Access points or unlocked Exit Stair doors
  - *Controlled Access* : Use Controlled Access points with from MCC



\* SRPD issued by RadCon Division or through Public Affairs Office

# Personnel Access System




Message  
Display

Magnetic  
Lock

Access Key  
Bank

# Using the PSS

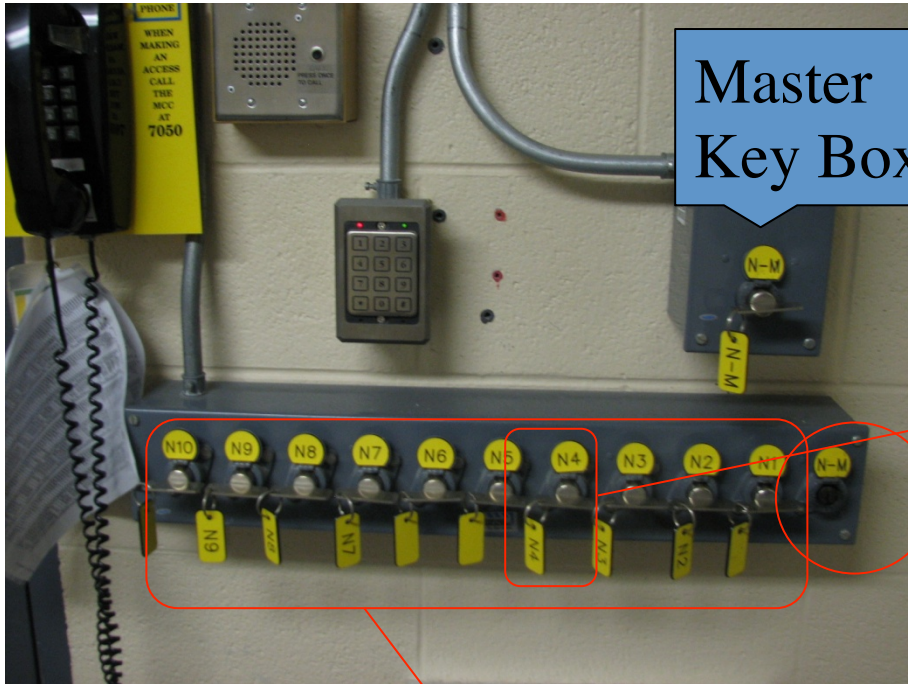

Master Key Box

Exchange Key #

Master Key Slot

10 Exchange Keys

# Exiting the Tunnel

- Check Status Display Screen for *Restricted Access* or *Controlled Access*
- If *Restricted Access*, open the door and proceed in
- If *Controlled Access*,



Safety System Operator (SSO) at ex.7050  
the outer door be unlocked

the Access Room, call the SSO to  
and ODH requirements  
Master Key

